NOTE:CONNECTION TO MAIN LINE AND FIRST AUXILIARY VALVE SHALL BE FLANGED.

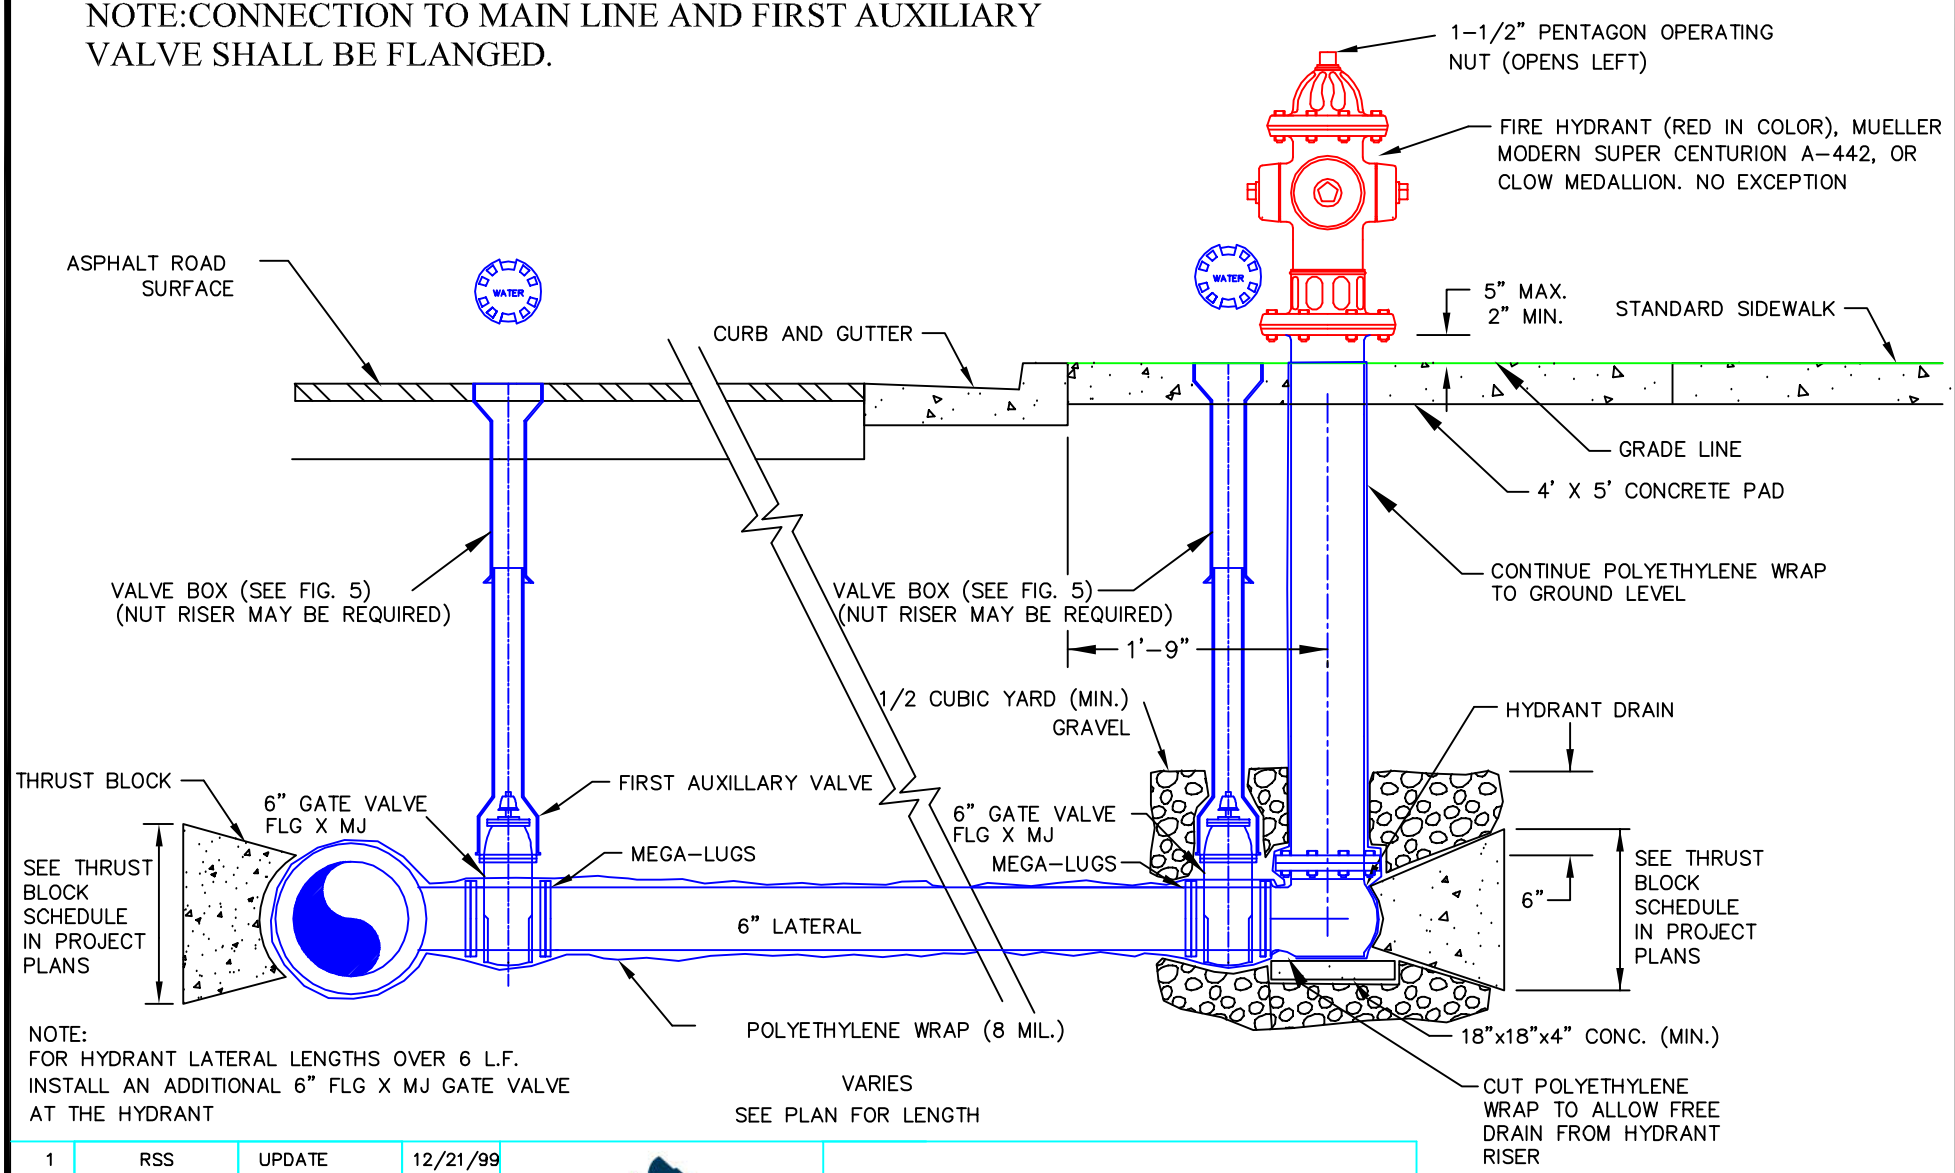

NOTE:
FOR HYDRANT LATERAL LENGTHS OVER 6 L.F.
INSTALL AN ADDITIONAL 6" FLG X MJ GATE VALVE
AT THE HYDRANT

NO.	AUTHORIZED BY	REVISIONS	DATE
1	RSS	UPDATE	12/21/99
2	RSS	REVIEWED	2004
3	RSS	UPDATE	4/24/08
4	CC	UPDATE	1/2010

Sandy PUBLIC UTILITIES

STANDARD DETAIL

FIGURE_02

FIRE HYDRANT CONNECTION

SCALE: NONE