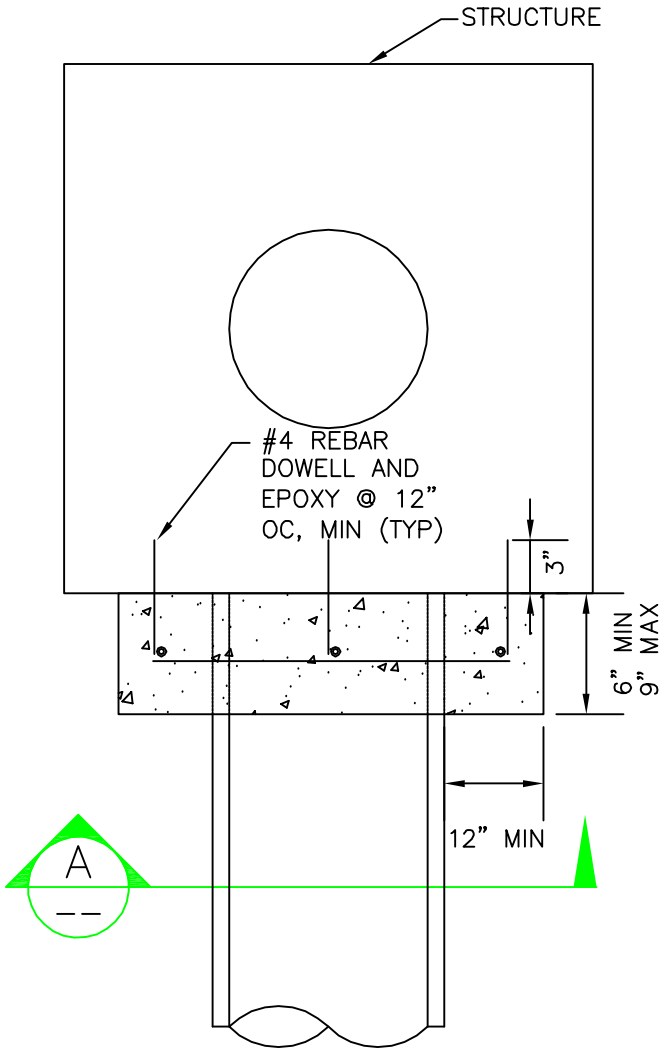

PIPE TO STRUCTURE COLLAR

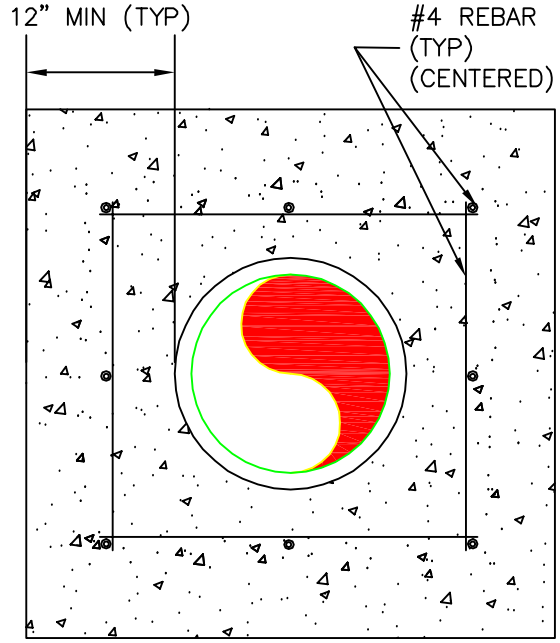

SECTION A

GENERAL NOTES

1. ALL CONCRETE SHALL BE CLASS AA (AE). SANDY CITY STANDARD SPECIFICATIONS SECTION 03000.
2. ALL REIINFORCING STEEL SHALL BE INTERMEDIATE GRADE 40, AND SHALL HAVE A MINIMUM OF TWO INCHES COVER OR CLEARANCE FROM ALL SURFACES AND OPENINGS, UNLESS OTHERWISE SPECIFIED.
3. IF A KNOCK-OUT IS USED, THE COLLAR SHALL COVER THE ENTIRE SIDE OF THE STRUCTURE.

NO.	AUTHORIZED BY	REVISIONS	DATE
1	RSS	UPDATE	12/21/99
2	CC	UPDATE	1/2010

Sandy PUBLIC UTILITIES

STANDARD DETAIL

FIGURE_14

PIPE TO STRUCTURE COLLAR

SCALE: NONE