WEIGHT OF CONCRETE TO RESIST
100% OF TOTAL THRUST

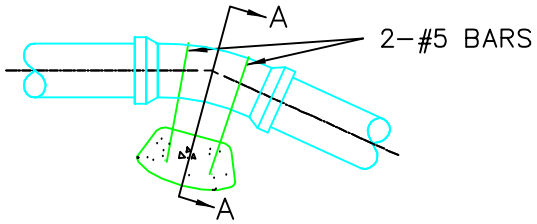

VERTICAL BEND

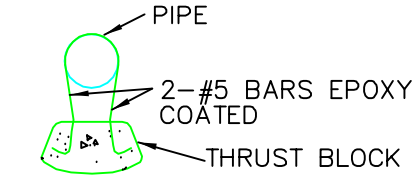

SECTION A-A

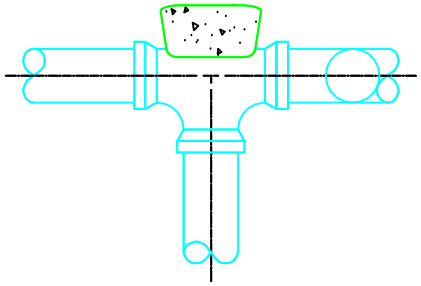

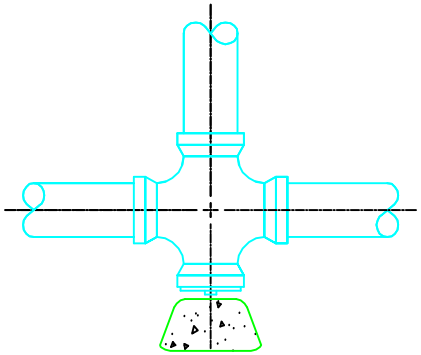

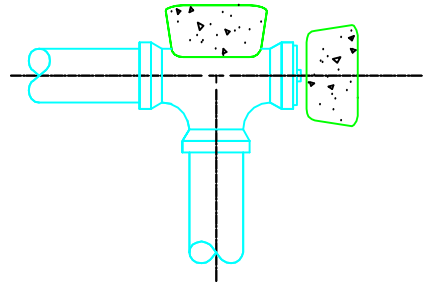



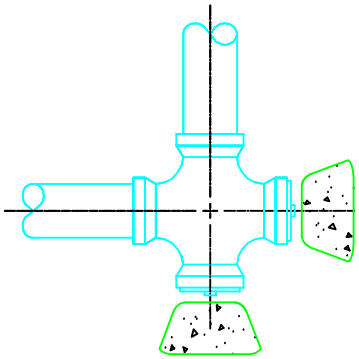

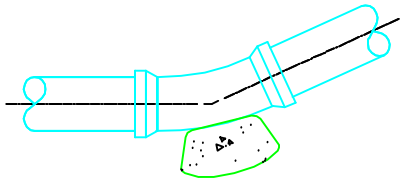

HORIZONTAL BEND



NOTES:

1. THRUST BLOCK TO BE SIZED USING 200 PSI AND SOIL BEARING PRESSURE AS DETERMINED FROM A SITE SPECIFIC SOILS REPORT.

2. REFER TO THRUST BLOCK TABLE IN THE PROJECT PLANS FOR MINIMUM CONCRETE BEARING AREAS AND DIMENSIONS

NO.	AUTHORIZED BY	REVISIONS	DATE
1	RSS	UPDATE	12/21/99
2	CC	UPDATE	1/2010

Sandy PUBLIC UTILITIES

STANDARD DETAIL

FIGURE_07

THRUST BLOCK INSTALLATIONS