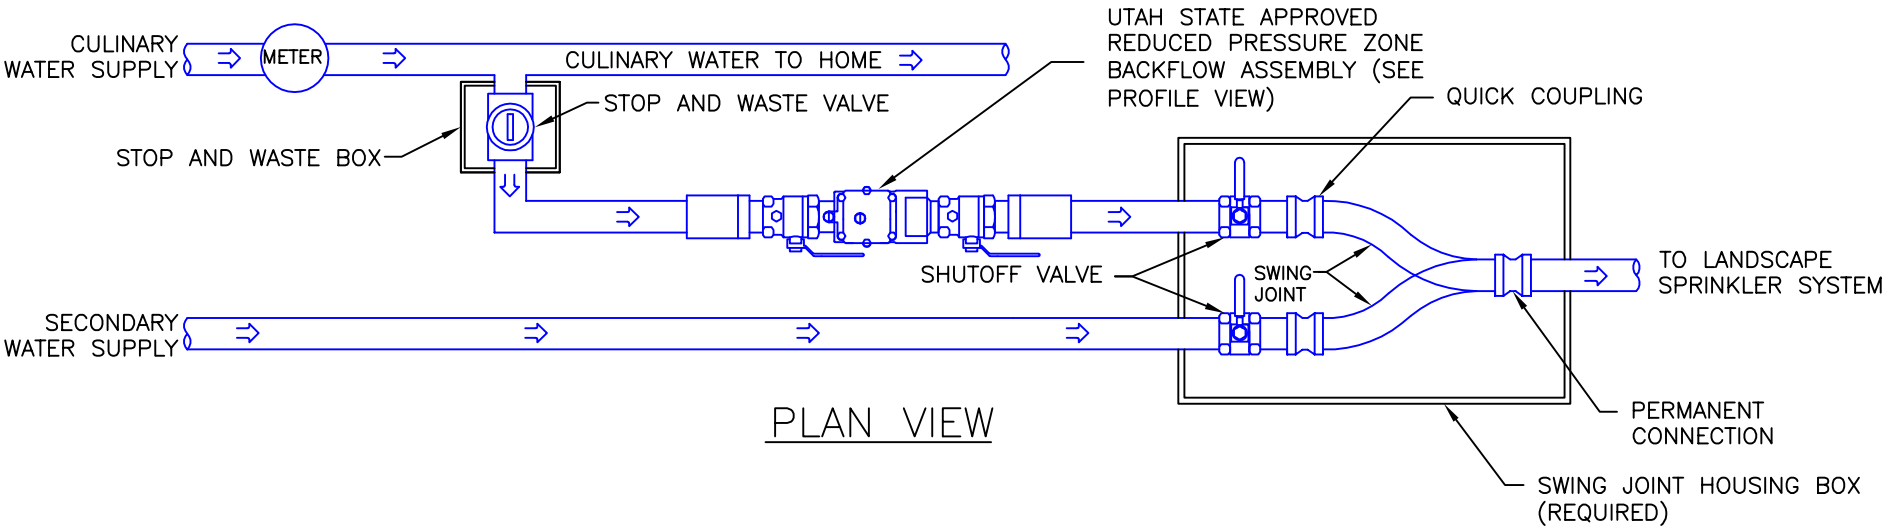

PLAN VIEW

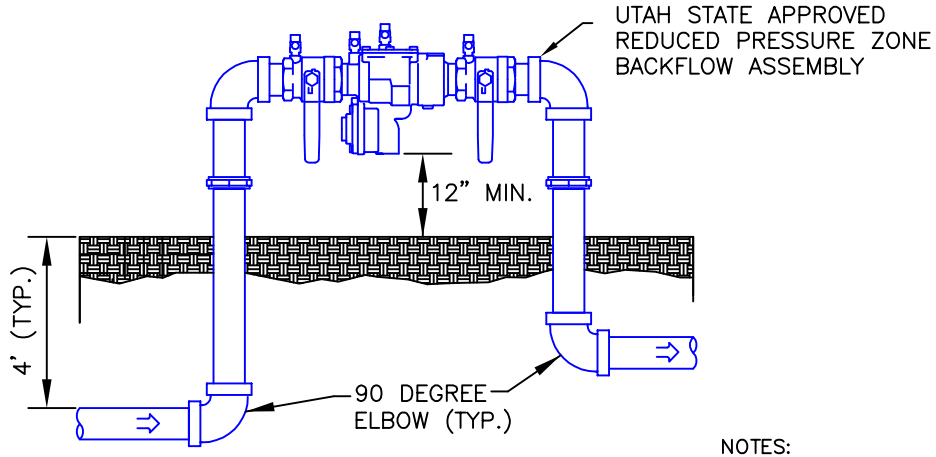

PROFILE VIEW

NOTES:

1. SWING JOINT MAY NOT BE CONNECTED TO BOTH CULINARY AND SECONDARY SUPPLY AT THE SAME TIME.
2. ALL MATERIAL FOR SWING JOINT SHALL HAVE A MINIMUM PRESSURE RATING OF 120 PSI.
3. REDUCED PRESSURE ZONE BACKFLOW ASSEMBLY SHALL BE 12 INCH MIN ABOVE THE GRADE LINE (POTENTIAL FLOOD LINE).

NOT TO SCALE

NO.	AUTHORIZED BY	REVISIONS	DATE
1	CC	CREATED	6/2017

Sandy
HEART OF THE WASATCH

STANDARD DETAIL
PUBLIC UTILITIES

WTR–15

DUAL SOURCE SYSTEM
UTILIZING SWING JOINT